


CALL DEA ENERGY SERVICES
AFTER WIRING IS COMPLETED TO
SCHEDULE METER INSTALLATION

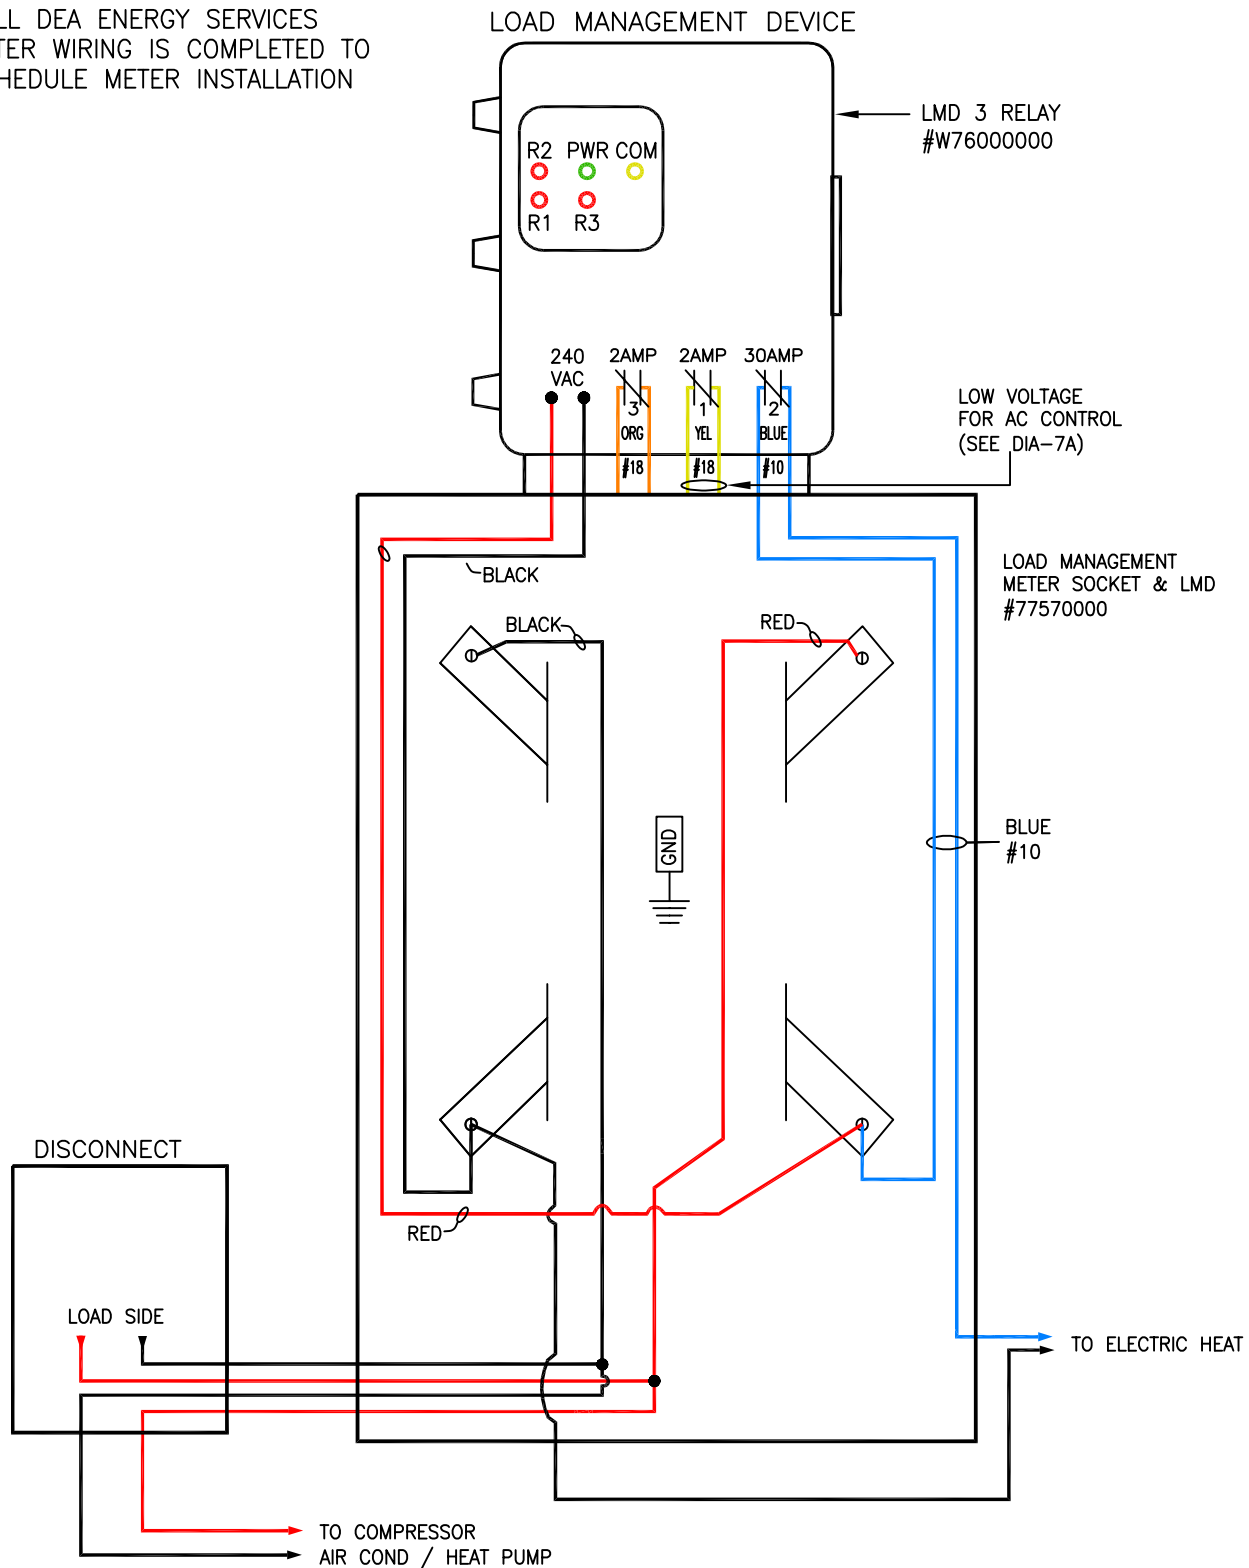

NOTES:

1. METER SOCKET & RECEIVER LOCATED OUTSIDE 4' TO 6' ABOVE GROUND LEVEL. OR ALIGNED WITH EXISTING METER.
2. CONNECTED HEAT LOAD SHALL NOT EXCEED 5KW (20 AMPS).
3. ALL WIRING SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE. (NEC)

DAKOTA ELECTRIC ASSOCIATION		
GUIDE DRAWING		SUB-METERED-ELECTRIC HEAT AND NON-METERED A/C HEAT PUMP SAME CIRCUIT CLASS 1-2 / DIV 8-15
OWNER	ENG. MANAGER	NO.
DATE	02/28/2023	DIA-11E

THIS DRAWING WAS DEVELOPED FOR
A TYPICAL INSTALLATION AND MAY
NOT BE APPLICABLE TO ALL
INSTALLATIONS CONSULT AN EXPERT
FOR FINAL INSTALLATION DESIGN