


CALL DEA ENERGY SERVICES  
AFTER WIRING IS COMPLETED TO  
SCHEDULE METER INSTALLATION

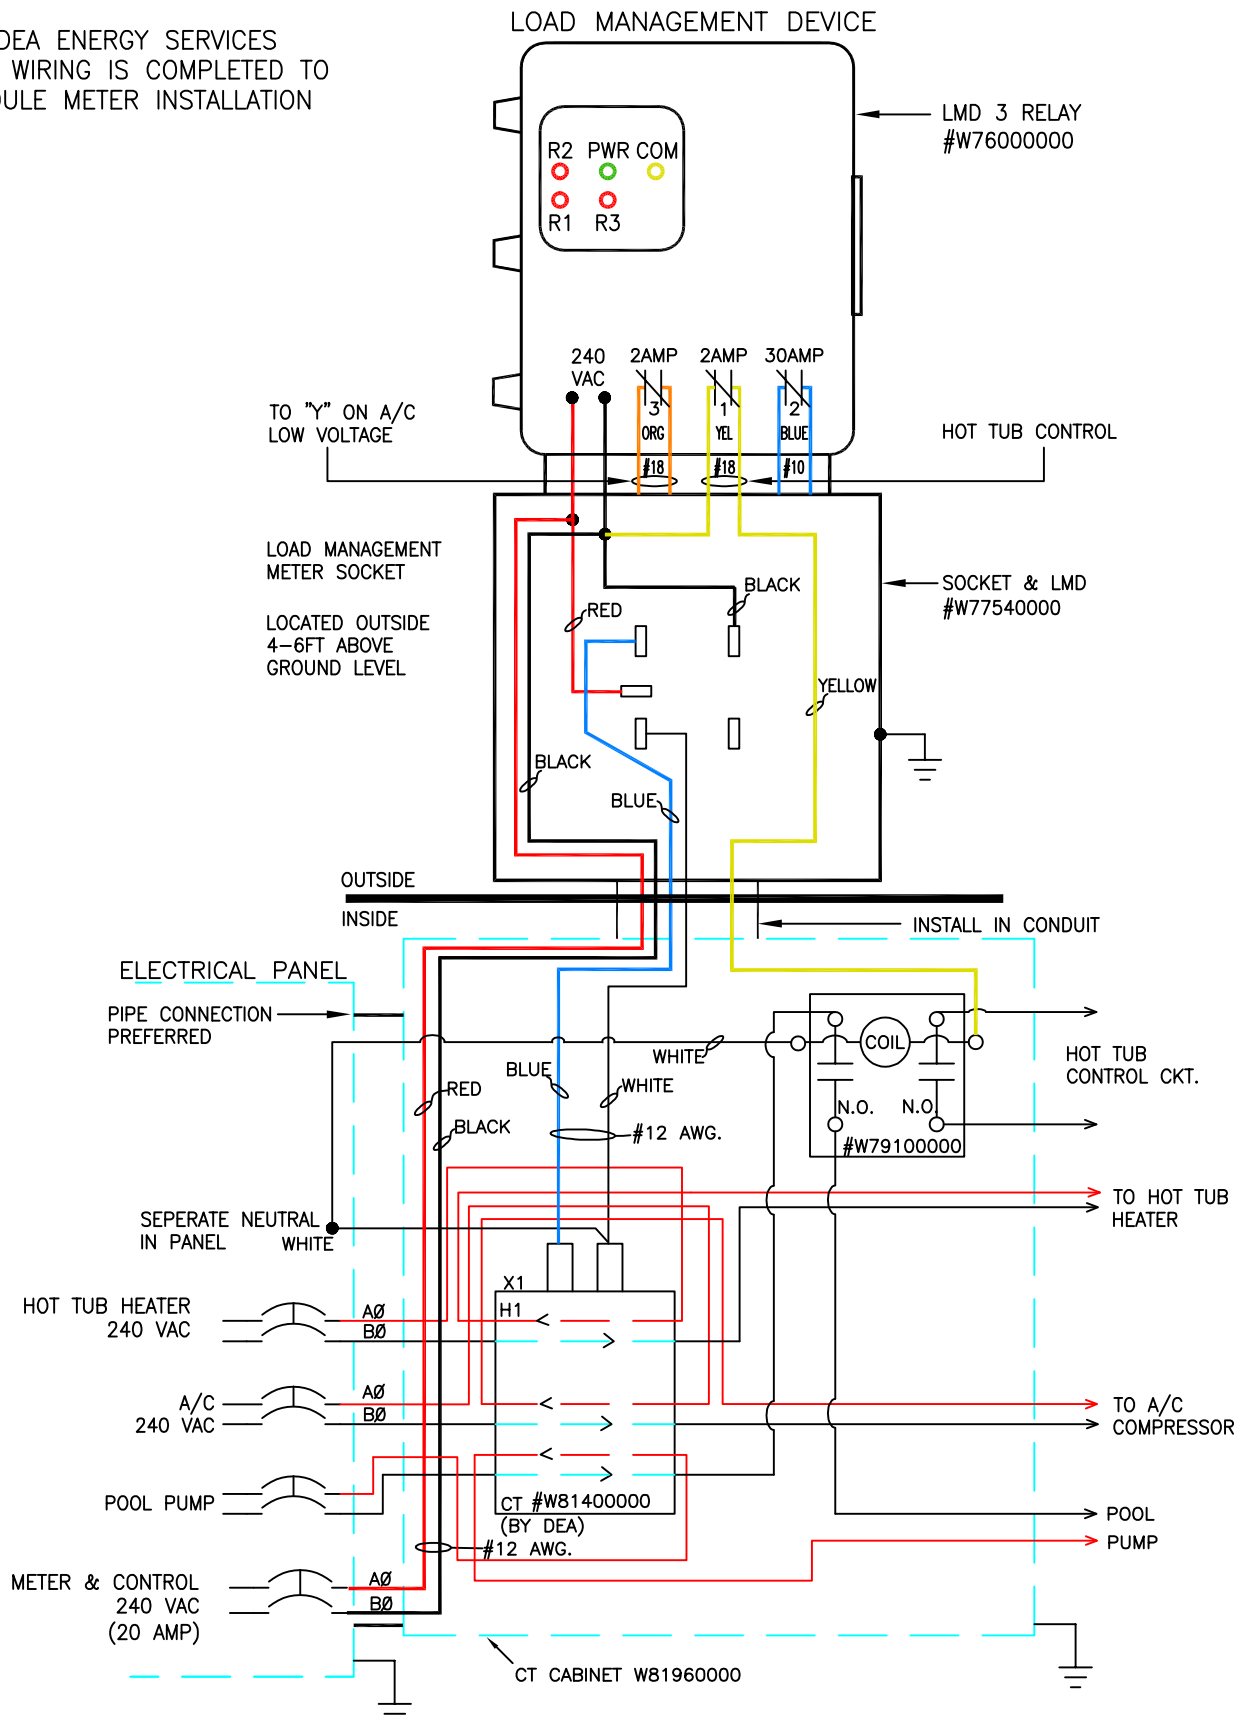

NOTES:

1. ALL WIRING SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE (NEC) AND LOCAL REGULATIONS.
2. METER SOCKET MUST HAVE BYPASS TO SHUNT CT WHEN METER IS REMOVED.
3. CT MUST BE GROUNDED AT ELECTRICAL PANEL.
4. LABEL OFF PEAK CONTROL BREAKER.
5. FOR OUTDOOR HOT TUBS CONTROL HEATERS ONLY.
6. OPTION: MOUNT SEPERATE LCR TO CONTROL HOT TUB HEATER.

DAKOTA ELECTRIC ASSOCIATION			
GUIDE DRAWING  THIS DRAWING WAS DEVELOPED FOR A TYPICAL INSTALLATION AND MAY NOT BE APPLICABLE TO ALL INSTALLATIONS CONSULT AN EXPERT FOR FINAL INSTALLATION DESIGN	SUB METERED—HOT TUB POOL PUMP AND A/C		
	CLASS 1 / DIV 16		
	OWNER	ENG. MANAGER	NO.
	DATE	02/28/2023	DIA—14A