


CALL DEA ENERGY SERVICES
AFTER WIRING IS COMPLETED TO
SCHEDULE METER INSTALLATION

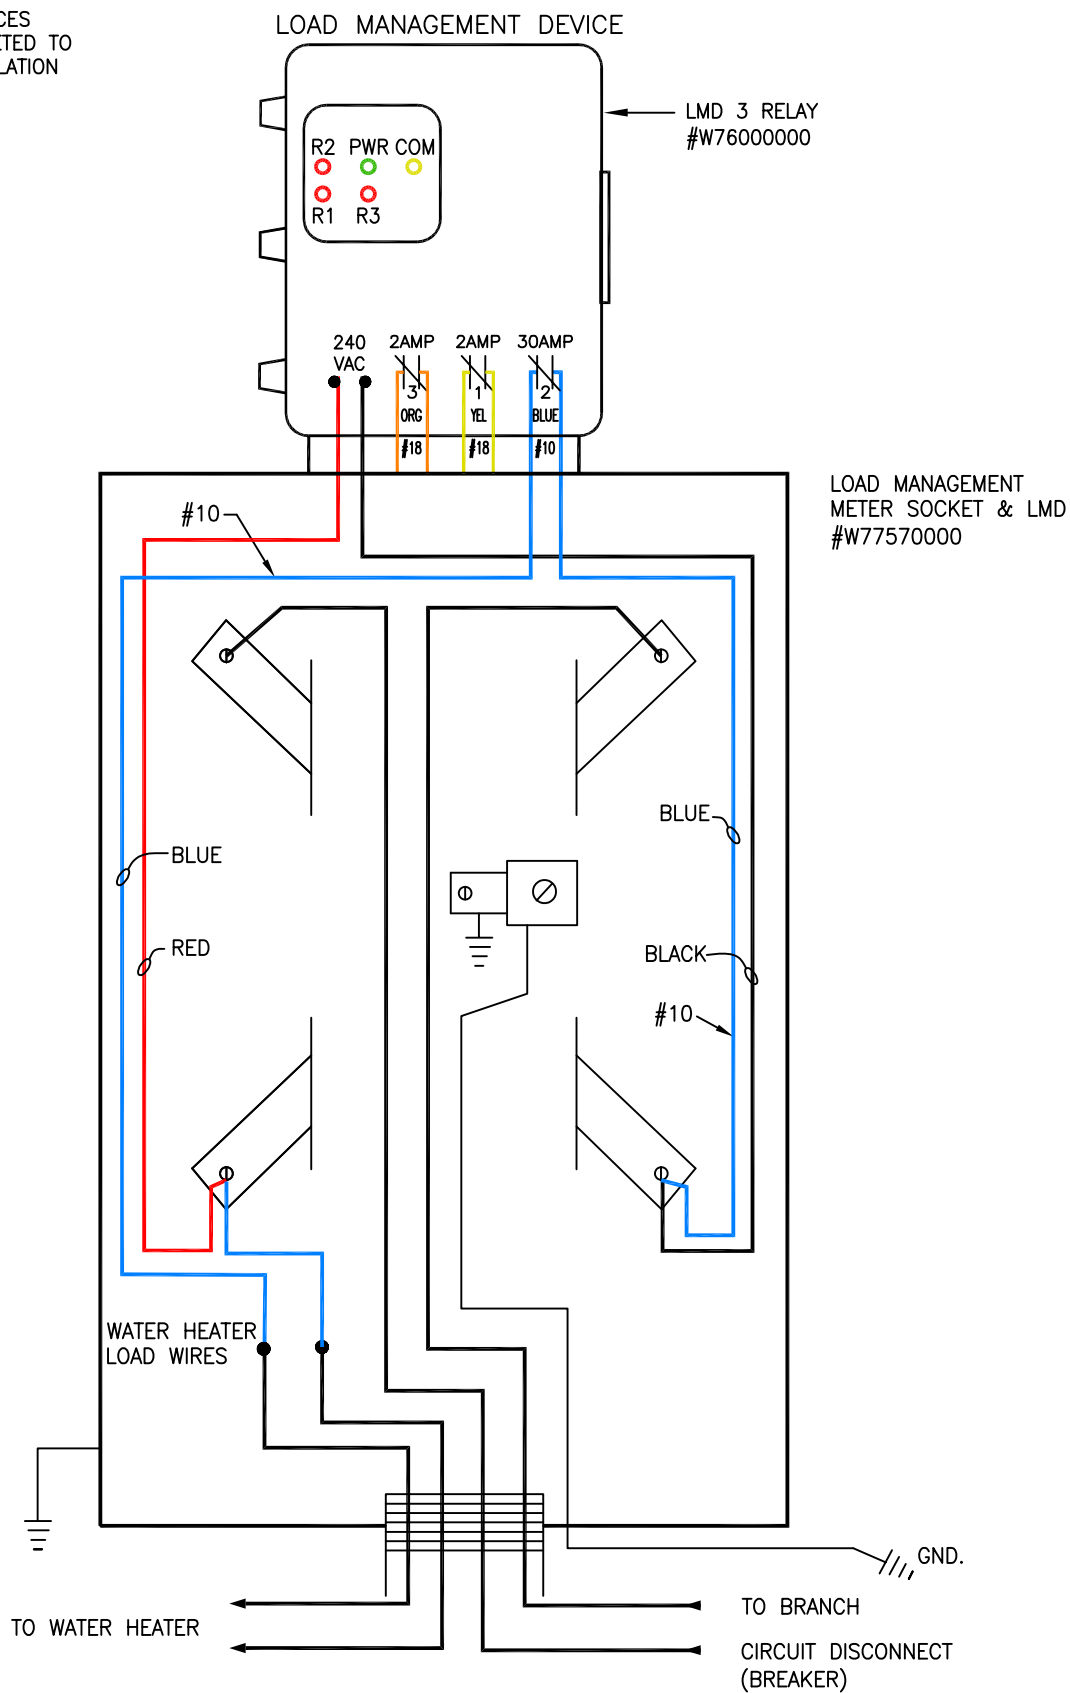

NOTES:

1. METER SOCKET & RECEIVER LOCATED OUTSIDE 4' TO 6' ABOVE GROUND LEVEL. OR ALIGNED WITH EXISTING METER.
2. ALL WIRING SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE. (NEC)

DAKOTA ELECTRIC ASSOCIATION		
GUIDE DRAWING		METERED-OFF PEAK WATER HEATER
THIS DRAWING WAS DEVELOPED FOR A TYPICAL INSTALLATION AND MAY NOT BE APPLICABLE TO ALL INSTALLATIONS CONSULT AN EXPERT FOR FINAL INSTALLATION DESIGN		CLASS 1 / DIV 1-8
OWNER	ENG. MANAGER	NO.
DATE	02/28/2023	DIA-5