


CALL DEA ENERGY SERVICES  
AFTER WIRING IS COMPLETED TO  
SCHEDULE METER INSTALLATION

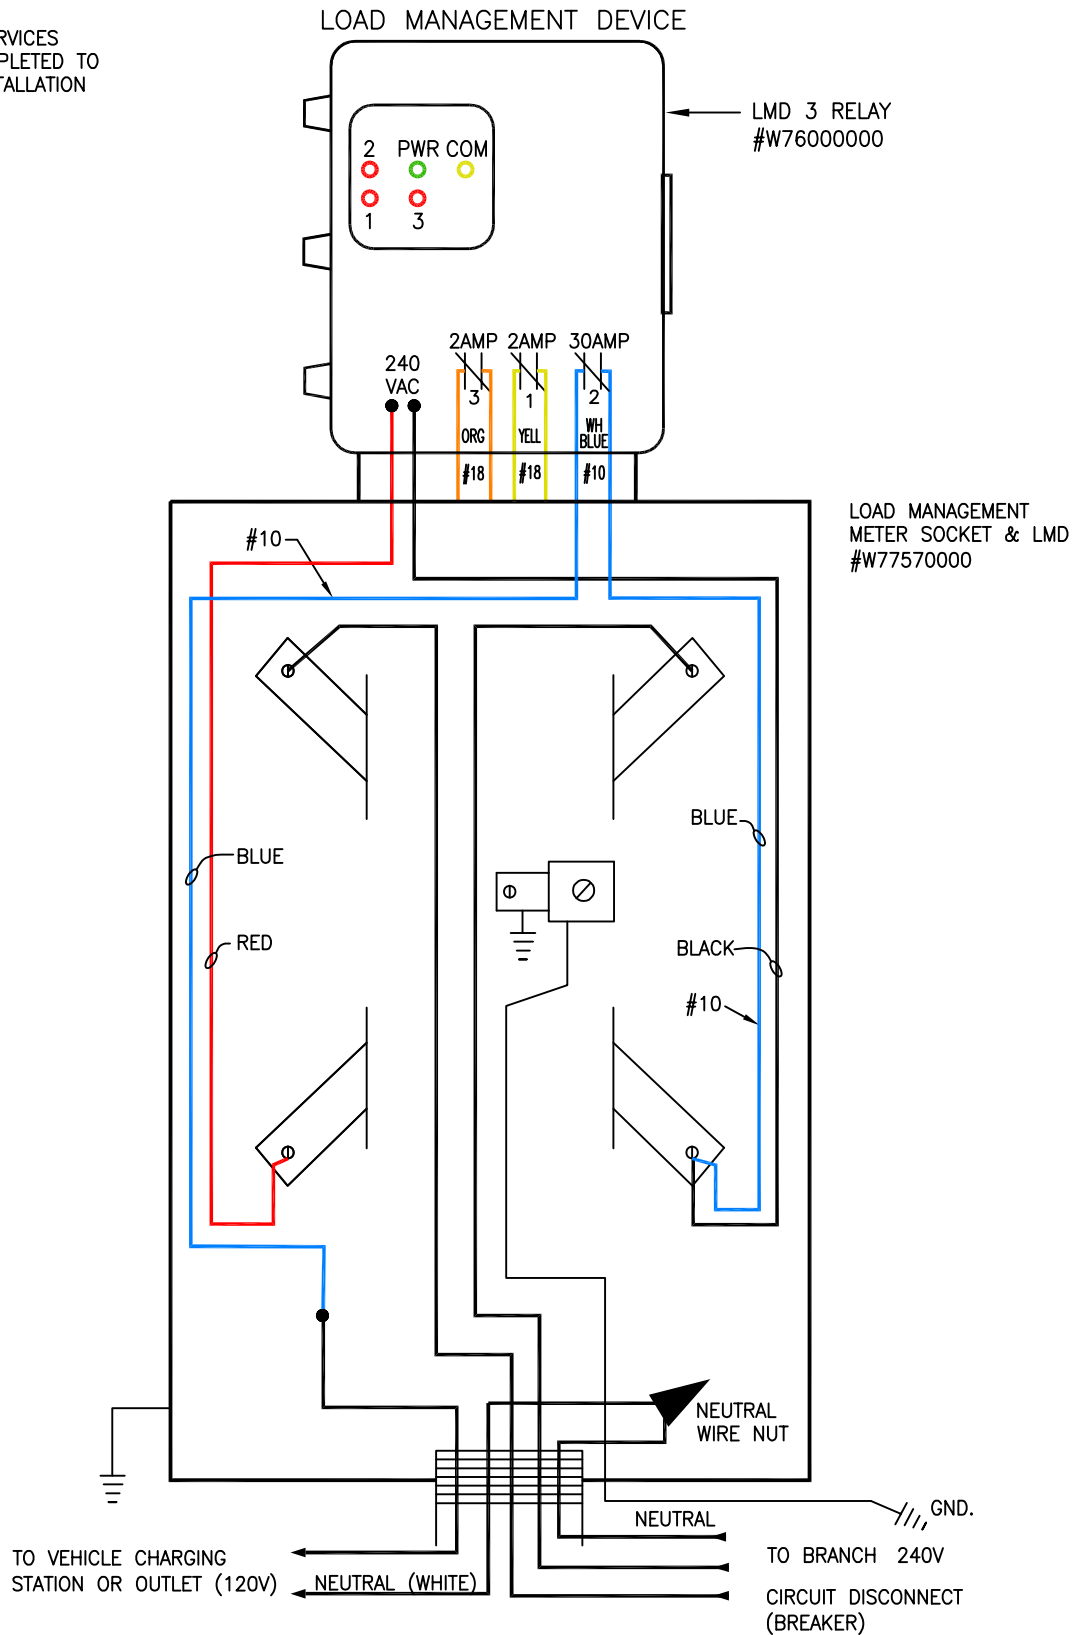

**NOTES:**

1. 240V REQUIRED TO METER SOCKET  
TO POWER LOAD CONTROL SWITCH AND METER.
2. METER SOCKET & RECEIVER LOCATED OUTSIDE 4' TO 6' ABOVE  
GROUND LEVEL. OR ALIGNED WITH EXISTING METER.
3. ALL WIRING SHALL MEET THE REQUIREMENTS OF THE  
NATIONAL ELECTRICAL CODE. (NEC)

DAKOTA ELECTRIC ASSOCIATION		
GUIDE DRAWING		METERED-OFF PEAK ELECTRIC VEHICLE 120V
THIS DRAWING WAS DEVELOPED FOR A TYPICAL INSTALLATION AND MAY NOT BE APPLICABLE TO ALL INSTALLATIONS CONSULT AN EXPERT FOR FINAL INSTALLATION DESIGN		
OWNER	ENG. MANAGER	NO.
DATE	02/28/2023	DIA-5EV-120