


LOAD CONTROL RECEIVER

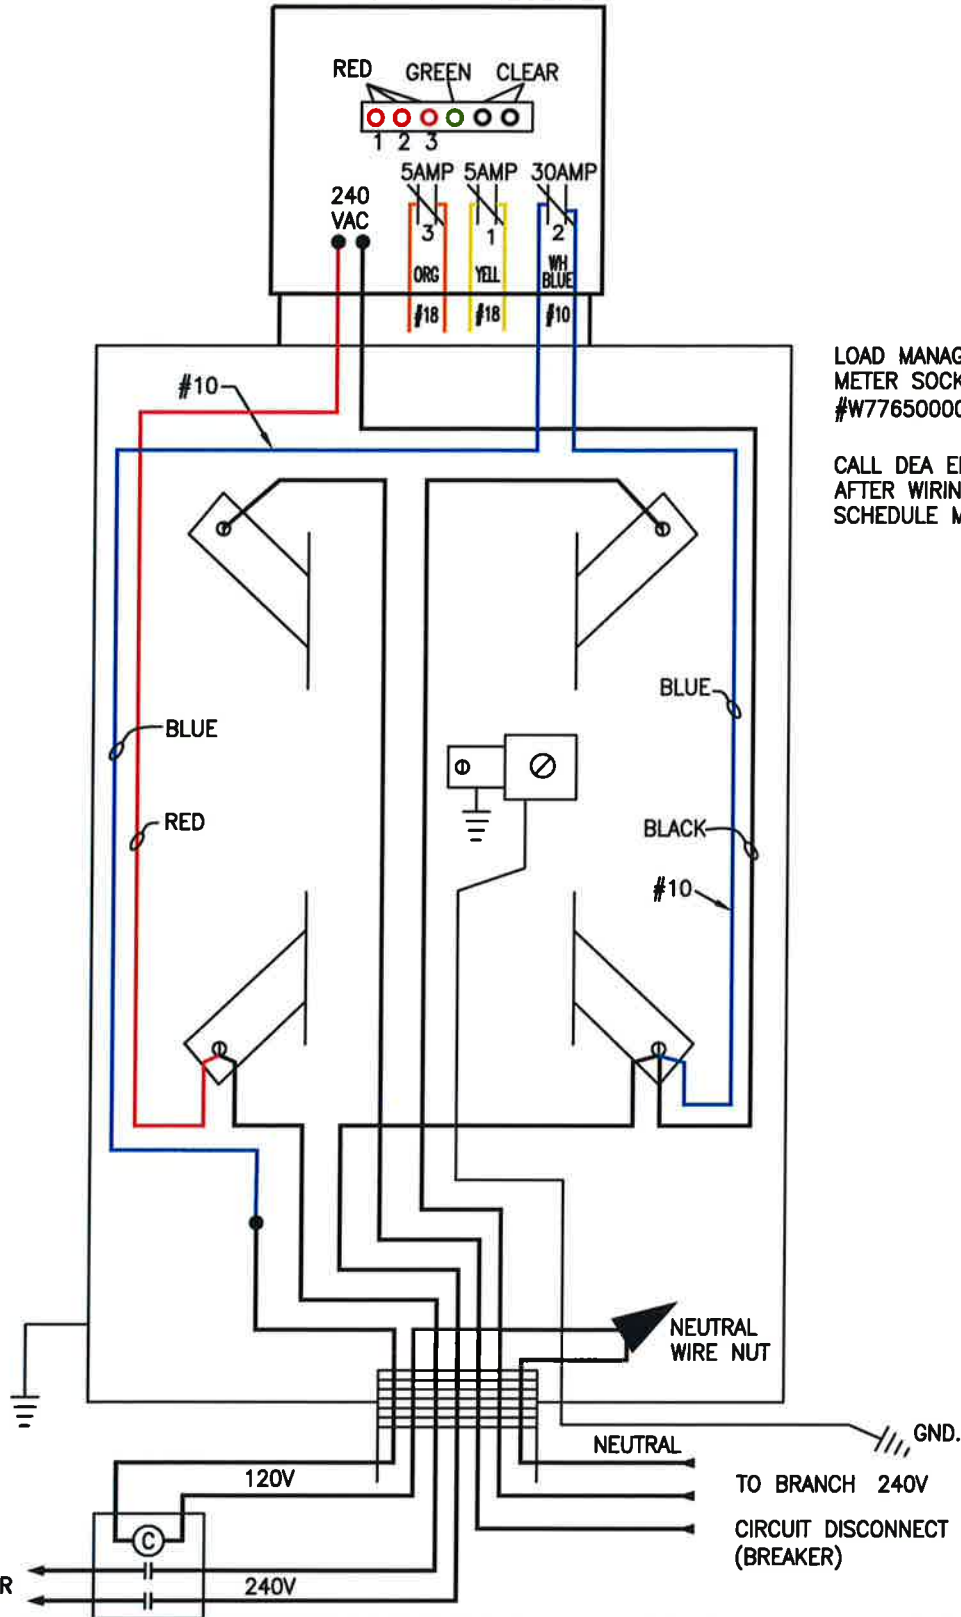

LOAD MANAGEMENT  
METER SOCKET & LCR  
#W77650000

CALL DEA ENERGY SERVICES  
AFTER WIRING IS COMPLETED TO  
SCHEDULE METER INSTALLATION

NOTES:

1. METER SOCKET & RECEIVER LOCATED OUTSIDE 4' TO 6' ABOVE GROUND LEVEL. OR ALIGNED WITH EXISTING METER.
2. ALL WIRING SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE. (NEC)
3. MEMBER OWNED RELAY MUST BE RATED FOR INTERRUPTING ENTIRE VEHICLE CHARGER LOAD.

DAKOTA ELECTRIC ASSOCIATION

GUIDE DRAWING

THIS DRAWING WAS DEVELOPED FOR A TYPICAL INSTALLATION AND MAY NOT BE APPLICABLE TO ALL INSTALLATIONS CONSULT AN EXPERT FOR FINAL INSTALLATION DESIGN

METERED-OFF PEAK  
ELECTRIC VEHICLE 240V  
MORE THAN 30 AMPS

OWNER ENG. MANAGER  
DATE 06/28/17

NO.  
DIA-5EV-240X